



Linear Heat Detection Systems for Fire Detection Controllers OTS1000(-LR) to OTS4000(-LR)



General

Controllers of the OTS product series are linear heat detection (LHD) devices for fire detection along optical fibres. A single LHD device provides fast and spatially well-resolved fire detection along 1 or 2 optical fibres with lengths of up to 4 km. Sensor fibres are immune to electrical interference and can be used in harsh environments. There is no cross-sensitivity to dust or diesel exhaust particulates as for smoke detectors. Redundant fire detection systems can easily be set up using multiple LHD devices and/or dual channel LR2-devices. OTS controllers can be operated at remote locations without PC. They transfer alarms and other data via relays and via standard network protocols to PC in control centres, SCADA or PLC systems.

Physical Background

LIOS OTS controllers use the effect of Raman scattering within optical fibres for temperature measurement. Laser radiation introduced in such a fibre is inelastically scattered transferring energy from or to vibrations of the glass molecular structure. Excitation of glass vibrations reduces the energy of the light photons and thus causes a signal at longer wavelength (Stokes signal). Annihilation of vibrations causes signals at shorter wavelength (anti-Stokes signal). The ratio of excitation and annihilation of vibrations depends on the portion of excited vibrations in the material and thus on the temperature. This effect allows for optical measurements of temperatures in fibres just by introducing laser light and by measuring the intensity ratio at the Stokes and anti-Stokes wavelengths. Spatial resolution is achieved by the optical frequency-domain reflectometry (OFDR) measuring technology.

Unique OFDR-LHD Measuring Technology

OFDR is a modulation technology to analyze the distance of signal sources. The light source is modulated at different frequencies and the amplitude and phase of signals coming back

from the fibre are measured. The mathematical Fourier transformation of the amplitude and phase data provides the spatial distribution of the signal sources. This is an elegant method to gain high spatial resolution with a quasi-continuous light source. Distributed temperature sensing using OFDR is a proprietary technology of LIOS Technology that has been developed and optimized during the last 10 years. Essential benefits of the LHD based on OFDR are elimination of laser wear out by quasi-continuous operation of a semiconductor laser, clearly reduced requirements for costly fast detection electronics and signal-to-noise improvements achieved by the quasi-continuous excitation light and the narrowband detection scheme. In contrast to pulse techniques, OFDR does not suffer from pulse broadening, and it thus gives constantly high spatial resolutions over very long distances.

High Reliability and Industrial Strength

The semiconductor laser diode has been thoroughly type tested according the Telcordia GR-468 standard. It fulfils telecom standards with a medium lifetime of > 25 years. The entire system was comprehensively evaluated by various independent international bodies (e.g. the VdS, the association of German asset insurers) including EMC tests as well as endurance tests at accelerated aging environments.

Field data of the huge installed base prove the exceptional high reliability of the controllers.

System Design

The OTS controllers have a modular design consisting of the following sub-modules:

- Modulated eye-safe laser source
- Optical filter and receiver
- Digital signal processing
- Power supply
- Optional communication module

The controller is connected to 1 or 2 sensor fibres by standard telecommunication plugs. The back-scattered Raman light is spectrally filtered and converted into electrical signals by means of photo detectors and amplifiers. Signal mixing and frequency filtering serves for high signal-to-noise ratios. Fourier transformation of the digitized signals results in Stokes and anti-Stokes Raman backscatter profiles. The temperature along the fibre is calculated from the ratio of the two signals using patented calibration algorithms.

The OTS controller can be operated at 24 VDC or optionally at 115/230 VAC power supplies. A PC or Laptop is used for commissioning the OTS. Temperature measurements, further data and event processing as well as data logging are autonomously conducted by the OTS without need for a computer during operation. Temperature profiles, event and alarm messages can be transmitted via standard local and optional network interfaces from the controller to PC, SCADA or PLC systems.

Fire Detection Classification

The OTS controllers of the latest generation provide accurate and fast fire detection even over very long distances enabled by the unique OFDR capabilities and sophisticated data processing including proprietary dynamic averaging algorithms. Response classes are certified by VdS for different controller types as given in the table.

Controller	Channels	Range / channel (km)	Response class
OTS1000	1	1	A1
OTS2000	1	2	A1
OTS3000	1	3	A1
OTS4000	1	4	A1
OTS1000-LR2	2	1	A1R
OTS2000-LR2	2	2	A1R
OTS3000-LR2	2	3	A1R
OTS4000-LR2	2	4	A1R

Software

CHARON_02 configuration and visualisation software provides comfortable access to the OTS system. CHARON_02 guides the user during system commissioning and maintenance phase. Several display languages and localisations are supported. The measurement and configuration data are stored in a database for convenient access. Data visualisation and configuration reports present desired information in a comprehensive shape. The enhanced visualisation options of CHARON_02 offer unlimited customisable views of data to the user. Data export, import and software interfaces (DDE, XML) support third party tools.

Rack mounting

The controllers are ready for 19" rack mounting. Rack mounted systems with controller and computer are available on request.

Optional Communication Protocols

The optional communication module provides an Ethernet interface enabling direct links of the controller to PC, SCADA and PLC systems via industry standard protocols like DNP3, IEC 60870-5, Modbus and XML based data interfaces such as Lab-View and Energistics WITSML.

Zone Processing and Alarm Actuation

Data points along the fibre can be split into up to 128 zones for separate evaluation of temperatures. Individual actuating parameters and outputs can be allocated for each zone. The OTS controllers can address a separate layer of up to 640 adjacent sub-zones using an extended alarm processing.

An alarm is actuated when one of the alarm criteria is exceeded in a zone:

- Maximum / minimum temperature
- Short and long-term temperature gradients (heating / cooling rates)
- Spatial temperature gradient (hot / cold spot)

Criteria can be set individually for each zone. To ensure a high degree of immunity to false alarm, the alarm notification can be delayed over multiple measuring cycles.

Fibre Break Detection

The OTS controllers indicate fibre breaks reliably and provide the exact meter location of these incidents. Fibre breaks are treated as OTS events and are further processed individually by zones according configuration.

Stand-Alone Operation

The OTS includes an embedded central processing unit (CPU) and can be operated stand-alone without external computer. The OTS can auto-start measurements after powering up. It stores all configuration parameters permanently and provides a battery-backed event log with all alarms, events, fault messages and measurement statistics.

The OTS system can operate as an autonomous data logger using the optional communication module. All measured data is stored on the built-in flash disk drive. Data can be downloaded using CHARON_02. The huge storage capacity enables at least 72 hours up to months of stand-alone operation in dependence on measuring cycle time and resolution.


Technical Data

Measurement Specifications	
Distance range / channel	OTS1000 / OTS1000-LR2: 1 km OTS2000 / OTS2000-LR2: 2 km OTS3000 / OTS3000-LR2: 3 km OTS4000 / OTS4000-LR2: 4 km
Measurement channels	OTS*000: 1 channel OTS*000-LR2: 2 channels
Distance resolution	0.5 m to 3 m depending on range
Optical	
Connector position	Rear side
Fibre connector	E2000 APC 8° Laser safety: Enhanced connector with immediate laser shut-down if pigtail removed.
Laser classification	Class 1M laser product. Must be operated with a properly terminated sensor cable without dispatchable connectors.
Cable types	Metal Free FRNC (MF) 4 mm Fast Response FRNC (FR) 4 mm JETEC 10 mm for nuclear power plants Ex-Protection 10 mm Harsh Environment Cable 4 mm (For details see cable datasheets.)
Power supply	
DC power supply	20 to 30 V; 2.0 to 1.3 A
DC power consumption	< 39 W
DC socket	SUB-D 3WK3, 3pin
Mains (option)	85 to 264 V ~; 47 to 63 Hz; 0.8 to 0.3 A
AC power consumption	< 70 VA
Socket	IEC 60320-C14 (inlet)
Software	
CHARON_02	PC software for configuration, data management and visualization
Computer requirements for configuration and visualization	Intel Pentium 4 (2 GHz), 512 MB RAM, minimum 250 MB free HD memory
Operation systems	Windows NT 4.0, SP 6 or higher Windows 2000, SP 2 or higher Windows XP, Windows VISTA
Detailed software features	See Charon_02 software datasheet
Communication	
Data transfer	Zone minimum, maximum and average values, zone alarms, alarm locations, error messages and notes are available by public protocols designed for communication with third party systems as well as with LIOS software CHARON_02. Temperature profiles, backscattering curves are available as an option. Frequency raw data graphical displays are provided by CHARON_02 only.
Interface RS232	Socket SUB-D 9 pin male
Interface Ethernet (option)	10Base-T, 8P8C socket (RJ45); TCP/IP
Communication protocols (option)	MODBUS/TCP DNP3 over TCP IEC 60870-5-104

	LabView Energistics WITSML Further protocols are available on request.
Inputs	4 programmable logical inputs, Socket SUB-D 9 pin female, galv. isolated Input trigger logic configurable.
Outputs	10 or 19 programmable outputs, event notification, direct interface with third party supervisory systems, Socket SUB-D 25 pin female resp. SUB-HD 44, galvanically isolated Output trigger logic configurable.
Event memory	Battery-backed event log with all alarms, events, fault messages and measurement statistics, retrievable by CHARON_02.
Zone and event processing	
Number of zones	≤ 128
Number of sub zones (option)	≤ 640
Alarm actuation	Max. / min. temperature, 3 different temperature gradients, hot / cold spot and delay can be set individually for each zone
Operation conditions	
Operating temperature	0°C to 40°C
Storage temperature	-30°C to 70°C
Humidity	< 95% (non-condensing)
Maintenance	
Fan filters	Exchangeable
Fibre connector	To be cleaned before connecting pigtail
Compliance	
Fire Detection	EN 54-5 / VdS 2344 Certificate No. G204141
Protection class	IP30
EMC	EN 61000-6-2:2001 (Immunity for industrial environments) EN 61326:1997 +A1:1998 +A2:2001 EN 61000-3-2:2000
Electrical safety (AC power)	EN 61010-1:2001
Laser safety	EN 60825-1:2007
Dimensions / Weight	
Dimensions (HxWxD)	13.5 cm x 44.9 cm x 31.5 cm
Weight	10.2 kg
Rack mounting	3 HU 19" rack; min. depth and width 60 cm Rear side accessible or 80 cm wide swing frame

LIOS Technology GmbH
 LINEAR OPTICAL SENSORS
 Schanzenstrasse 39 Building D9-13
 51063 Cologne, Germany
 Phone: +49 221 998870, FAX: +49 221 99887150
 info@lios-tech.com
 MEMBER OF THE NKT GROUP

LIOS Technology "fast-response" Sensorkabel



mit Bündelader aus Edelstahl mit 2 Fasern, mit Edelstahldrähten und einem Außenmantel

B1-11-02-00-TL-500

X8030514 (PA Mantel)

B1-11-02-00-TL-600

X8030504 (HM4 Mantel)

LIOS Technology "fast-response" Sensor Cable

steel loose with 2 fibers, metal strength members and outer sheath


Order number:

B1-11-02-00-TL-500

X8030514 (PA Coating)

B1-11-02-00-TL-600

X8030504 (HM4 Coating)

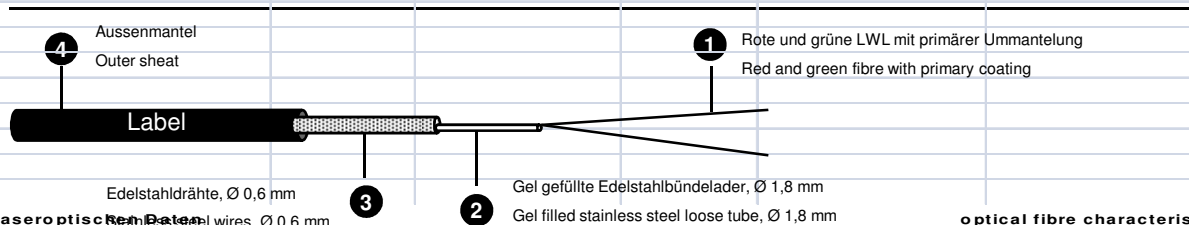

Faseroptische Sensorkabel wires, Ø 0,6 mm optical fibre characteristics

Fasertyp	GI-Faser	62,5/125	GI fibre	fibre type
----------	----------	----------	----------	------------

Das Sensorkabel erfüllt die herstellereigenen Richtlinien der Systemkalibrierung für den störungsfreien Betrieb als faseroptisches Temperaturmeßsystem
The sensor cable complies with the manufacturer's guidelines of system calibration for the undisturbed operation as temperature measurement system.

Mechanische Daten

mechanical characteristics

Kabeltyp		cable type			
Faserzahl	2	number of fibres			
Kabelgewicht	kg/km	44	cable weight		
Kabeldurchmesser	mm	4,0	cable diameter		
min. Biegeradius			min. bending radius		
ohne Zugbelastung	mm	60	without tensile loading		
mit Zugbelastung	mm	80	with tensile loading		
max. Zugkraft			max. tensile strength		
dauernd	N	1100	long term		
kurzzeitig	N	2000	short term		
max. Querdruck	N/cm	1000	max. crush resistance		
Schlagfestigkeit	n	Anz. Schläge mit 1Nm	20	number of impacts with 1Nm	impact resistance
Wiederholte Biegung (100N)	n	bei Radius 80mm	500	radius 80mm	repeated bending (100N)

Aussenmantel

outer sheath

Mantelmaterial	Polyamid oder HM 4	Polyamide or HM 4	outer sheath material
Mantelfarbe	schwarz	black	outer sheath colour
Mantelbeschriftung (weiß)	Auftragsnummer Lasersymbol Meterangabe [Label] Lasersymbol Optical Fibre Cable		labeling (white)
	production lot laser-label meter marking [Label] laser-label Optical Fibre Cable		

Temperaturbereich

temperature range

Betriebs-/Lagertemperatur	°C	-40 bis +85	operating-/storage temperature
Verlegetemperatur	°C	-5 bis +50	installation temperature
Kurzzeitige Temperaturbelastung	°C (max. 60min)	-50 bis +150	short term temperatur

Elektrische Eigenschaften

electrical characteristics

Durchschlagfestigkeit des Mantels	Veff.DC	5000	sheath insulation
-----------------------------------	---------	------	-------------------

Normen:

Standards:

Kabel gemäss EN 187000, IEC 60794	Cable according to EN 18700, IEC60794
Lichtwellenleiter gemäss IEC 60793	Fiber according to IEC 60793

Beschreibung:

Description:

Lichtwellenleiterschutz mittels hydrophobisches Gel.	The fibres are protected by hydrophobic gel
Längswasserdichte Bündelader	The loose tube is longitudinal watertight

LIOS Technology GmbH

LINEAR OPTICAL SENSORS
Schanzenstrasse 39, Building D9-D13
51063 Köln/Cologne, Germany

Phone.: +49 221 99887 0
Fax: +49 221 99887 150
E-Mail: info@lios-tech.com

Datenblatt: Sensorkabel Metal-frei frnc


Bündelader mit 2 Fasern, mit Aramidgarn und Aussemmantel
In Übereinstimmung mit B1-20-00-70-TL-030

Artikelnummer:
X8030606

Datasheet: Sensor cable metal-free frnc

loose tube with 2 fibres, aramide yarn and outer sheath
In accordance with B1-20-00-70-TL-030

Order number:
X8030606

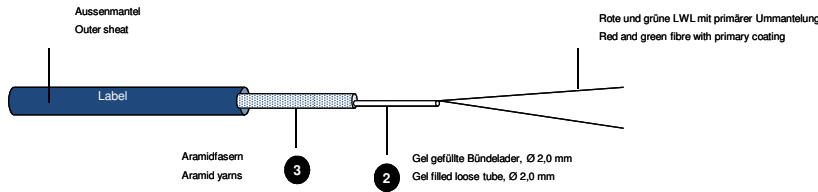

Faseroptischen Daten **optical fibre characteristics**

Fasertyp	GI -Faser	62,5/125	GI fibre	fibre type
----------	-----------	----------	----------	------------

Das Sensorkabel erfüllt die herstellereigenen Richtlinien der Systemkalibrierung für den störungsfreien Betrieb als faseroptisches Brandmeldesystem.
The sensor cable complies with the manufacturer's guidelines of system calibration for the undisturbed operation as fire detection system.

Mechanische Daten **mechanical characteristics**

Kabeltyp		cable type			
Faserzahl	2		number of fibres		
Kabelgewicht	kg/km	17	cable weight		
Kabeldurchmesser	mm	4,0	cable diameter		
min. Biegeradius			min. bending radius		
ohne Zugbelastung	mm	60	without tensile loading		
mit Zugbelastung	mm	80	with tensile loading		
max. Zugkraft			max. tensile strength		
dauernd	N	200	long term		
kurzzeitig	N	400	short term		
max. Querdruk	N/cm	90	max. crush resistance		
Schlagfestigkeit	n	Anz. Schläge mit 1,5 Nm	3	number impacts with 1,5 Nm	impact resistance
Wiederholte Biegung (100N)	n	bei Radius 40mm	1x5	radius 40mm	repeated bending (100N)

Aussemmantel **outer sheath**

Mantelmaterial	FRNC	outer sheath material	
Mantelfarbe	schwarz	black	outer sheath colour
Mantelbeschriftung (weiß)	Auftragsnummer Lasersymbol Meterangabe [Label] Lasersymbol Optical Fibre Cable	production lot laser-label meter marking [Label] laser-label Optical Fibre Cable	labeling (white)

Temperaturbereich **temperature range**

Betriebs-/Lagertemperatur	°C	-25 bis +70	operating-/storage temperature
Verlegetemperatur	°C	-5 bis +50	installation temperature
Kurzzeitige Temperaturbelastung	°C (max. 60min)	-50 bis +150	short term temperatur

Normen:

Kabel gemäss EN 187000. IEC 60794
Lichtwellenleiter gemäss IEC 60793

Standards:

Cable according to EN 18700. IEC60794
Fiber according to IEC 60793

Brandverhalten

Flammwidrigkeit gemäss IEC 60332-1-2
Rauchdichte gemäss IEC 61034-2
Halogenfreiheit gemäss IEC 60754-2
Brandlast 0,31 J/m

Flammability

Flame resistance according to IEC 60332-1-2
Smoke density according to IEC 61034-2
Halogen free according to IEC 60754-2
Fire load 0,31 J/m

LIOS Technology GmbH
LINEAR OPTICAL SENSORS
Schanzenstr. 39, Build. D9-D13
51063 Köln/Cologne, Germany
Phone.: +49 221 99887 0
Fax: +49 221 99887 150
E-Mail: info@lios-tech.com

Beschreibung:

Lichtwellenleiterschutz mittels hydrophobisches Gel.
Längswasserdichte Bündelader

Description:

The fibres are protected by hydrophobic gel
The loose tube is longitudinal watertight

Informationsmaterial zur Systemkalibrierung wird auf Anfrage zugesendet.

If requested we will send you a information sheet about the system calibration.

Stand / Revision:

18.06.09 / Ausgabe 001-FKU